


EFICIENȚA RECUPERATORULUI DE CĂLDURĂ

Values referred to the following conditions (UNI EN 13141-7): Tbs external air 7°C: U.R. esternal 72%; Tbs enviroment 20°C: U.R. enviroment 28%

— MICRO-REV

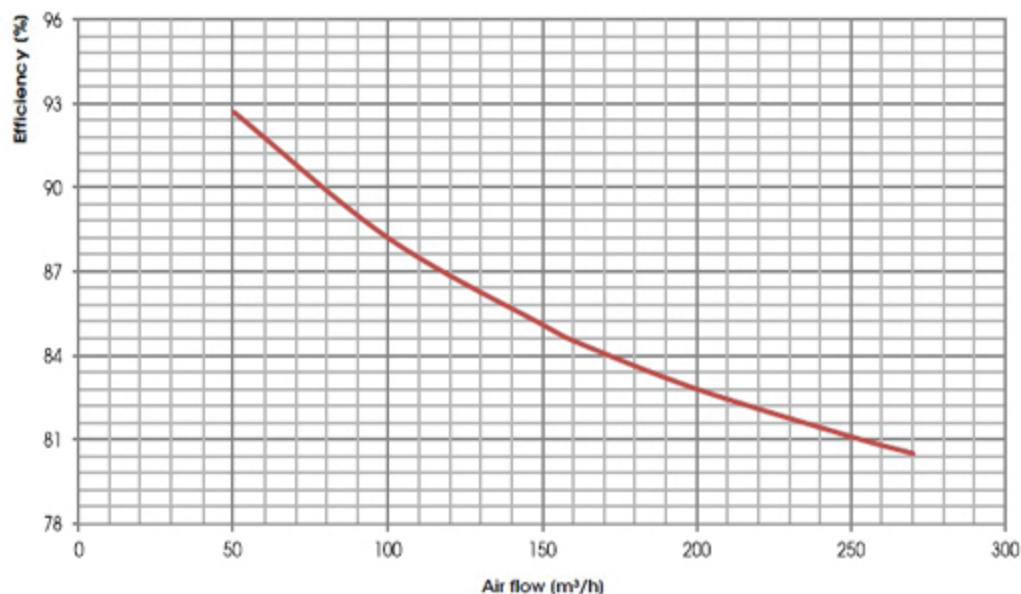

--- MICRO-REV ENTHALPIC/ U.R. = Latent heat recovery
— MICRO-REV ENTHALPIC/ T = Sensible heat recovery

